


Medium Voltage (24kv)




OBLUM
50 YEARS OF EXCELLENCE

Pioneering Cutting-Edge Solutions for Tomorrow



Powering Progress for Over Half a Century: We've been at the forefront of electrical polymer surge arresters manufacturing, continuously innovating for 50+ years, delivering solutions that energize the world.

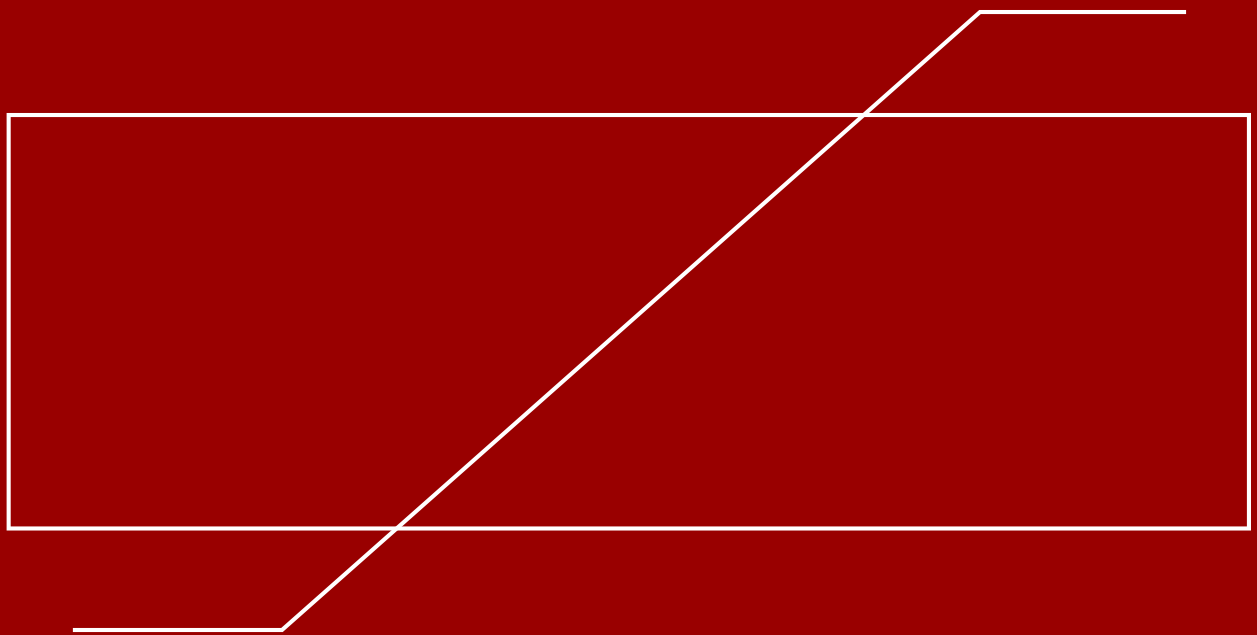



Global Presence

Oblum business operations are present in multiple geographies across the globe. We are committed to our vision of driving positive change in the environment and in the lives of people.



Asian Countries

- Philippines
- Iraq
- Bangladesh
- Srilanka
- Turkey
- Abu Dhabi
- Bhutan
- Malaysia
- Nepal
- Uganda
- Uae
- Afghanistan
- Vietnam
- Sharjah
- Nigeria
- Colombo
- Kabul
- Jordan
- Kenya
- Yemen
- Dubai
- Armenia
- Georgia
- Japan
- Kuwait

South American Countries

- Peru
- Paraguay

North American Countries

- Nicaragua
- Canada

European Countries

- Finland
- Spain

African Countries

- Kenya
- Rwanda
- Togo
- Mali
- Zambia
- Burkina Faso
- Mozambique
- Congo
- Tanzania
- Uganda
- South Africa
- Ivory Coast
- Ethiopia
- Botswana
- Liberia
- Transco Clsg
- Ghana
- Sierra Leone
- Gambia

Medium Voltage (24kv)

INDOOR SPF			
S No	Description	24kv 10kA SL	24kv 10kA SM
	Model	SPF	SPF
	OUTDOOR/ INDOOR	INDOOR	INDOOR
	System earthing	solidly / ineffectively earthed sytem	solidly / ineffectively earthed sytem
1	Highest system voltage kV rms	24	24
2	Nominal system voltage kVrms	22	22
3	Ur –Rated voltage kVrms	24	24
4	Uc –MCOV(kVrms)	20	20
5	In –NDC (8/20µs) kA	10	10
6	Arrester classification	Station Low duty	Station Medium Duty
7	Qrs(IEC 99-4 Ed.3) in coulomb	1	1.6
8	Wth (IEC 99-4 Ed.3) in kJ/kV	4	7
9	Qth (IEC 99-4 Ed.3) in coulomb		
10	Max RDV kVp		
	a) 5kA	68	64
	b) 10kA	72	68
	c) 20kA	80	76
11	Max. Switch. Imp. RDV(kVp)		
	a) 500A	57	
	b) 1000A		54
	c) 2000A		
12	Max. Steep Current impulse RDV(kVp) at NDC	80	76
13	High current impulse withstand value (4/10 µs) kA	100	100
14	TOV (kVp)		
	i. 0.1	42	42
	ii. 1.0Sec	41	41
	iii. 10.0Sec	39	39
	iv. 100.0Sec	37	37
15	Short circuit current kA	25/31.5 (as applicable)	25/31.5 (as applicable)
16	Insulation Withstand		
	a) Lightning Impulse (kVp)	As per IEC 60099-4 2014	As per IEC 60099-4 2014
	b) Power frequency kVrms	As per IEC 60099-4 2014	As per IEC 60099-4 2014
	c) Switching Imp (Wet)(kVp)	NA	NA
17	Rated frequency (Hz)	48 to 62	48 to 62
18	Leakage current		
	a. IR at MCOV in µA	Less than 400	Less than 400
	b. IC at MCOV in mA	About 1.2	About 1.4
19	Reference voltage in Volt at Reference current in mA	> 12kV at 2mA	> 12kV at 3mA
20	Partial discharge P.D	10pC	10pC
21	Creepage distance–mm (min) Phase to Phase	NA	NA
22	Max. Cantilever strength of arrester Kgf	NA	NA

DISTRIBUTION MEDIUM DUTY

S No	Description	24kV 10kA DH
	Model	PBW
	OUTDOOR/ INDOOR	
	System earthing	
1	Highest system voltage kV rms	24
2	Nominal system voltage kVrms	22
3	Ur –Rated voltage kVrms	24
4	Uc –MCOV(kVrms)	20
5	In –NDC (8/20µs) kA	10
6	Arrester classification	Distriution High duty
7	Qrs(IEC 99-4 Ed.3) in coulomb	0.4
8	Wth (IEC 99-4 Ed.3) in kJ/kV	
9	Qth (IEC 99-4 Ed.3) in coulomb	1.1
10	Max RDV kVp	
	a)5kA	72
	b)10kA	76
	c)20kA	84
11	Max. Switch. Imp. RDV(kVp)	NA
	a)500A	
	b)1000A	
	c) 2000A	
12	Max. Steep Current impulse RDV(kVp) at NDC	84
13	High current impulse withstand value (4/10 µs) kA	100
14	TOV (kVp)	
	i. 0.1	42
	ii.1.0Sec	41
	iii. 10.0Sec	39
	iv. 100.0Sec	37
15	Short circuit current kA	25/31.5 (as applicable)
16	Insulation Withstand	
	a)Lightning Impulse (kVp)	As per IEC 60099-4 2014
	b)Power frequency kVrms	As per IEC 60099-4 2014
	c)Switching Imp (Wet)(kVp)	NA
17	Rated frequency (Hz)	48 to 62
18	Leakage current	
	a.IR at MCOV in µA	Less than 400
	b. IC at MCOV in mA	About 1.2
19	Reference voltage in Volt at Reference current in mA	> 24kV at 1mA
20	Partial discharge P.D	10pC
21	Creepage distance–mm (min) Phase to Phase	25mm/kV /31mm/kV (as applicable)
22	Max. Cantilever strength of arrester Kgf	NA

MEDIUM STATION PBW

S No	Description	24kV 10kA SL	24kV 10kA SM
	Model	PBW	PBW
	OUTDOOR/ INDOOR		
	System earthing		
1	Highest system voltage kV rms	24	24
2	Nominal system voltage kVrms	22	22
3	Ur –Rated voltage kVrms	24	24
4	Uc –MCOV(kVrms)	20	20
5	In –NDC (8/20 μ s) kA	10	10
6	Arrester classification	Station Low duty	Station Medium Duty
7	Qrs(IEC 99-4 Ed.3) in coulomb	1	1.6
8	Wth (IEC 99-4 Ed.3) in kJ/kV	4	7
9	Qth (IEC 99-4 Ed.3) in coulomb		
10	Max RDV kVp		
	a) 5kA	68	64
	b) 10kA	72	68
	c) 20kA	80	76
11	Max. Switch. Imp. RDV(kVp)		
	a) 500A	57	
	b) 1000A		54
	c) 2000A		
12	Max. Steep Current impulse RDV(kVp) at NDC	80	76
13	High current impulse withstand value (4/10 μ s) kA	100	100
14	TOV (kVp)		
	i. 0.1	42	42
	ii. 1.0Sec	41	41
	iii. 10.0Sec	39	39
	iv. 100.0Sec	37	37
15	Short circuit current kA	25/31.5 (as applicable)	25/31.5 (as applicable)
16	Insulation Withstand		
	a) Lightning Impulse (kVp)	As per IEC 60099-4 2014	As per IEC 60099-4 2014
	b) Power frequency kVrms	As per IEC 60099-4 2014	As per IEC 60099-4 2014
	c) Switching Imp (Wet) (kVp)	NA	NA
17	Rated frequency (Hz)	48 to 62	48 to 62
18	Leakage current		
	a. IR at MCOV in μ A	Less than 400	Less than 400
	b. IC at MCOV in mA	About 1.2	About 1.4
19	Reference voltage in Volt at Reference current in mA	> 24kV at 2mA	> 24kV at 3mA
20	Partial discharge P.D	10pC	10pC
21	Creepage distance–mm (min) Phase to Phase	25mm/kV /31mm/kV (as applicable)	25mm/kV /31mm/kV (as applicable)
22	Max. Cantilever strength of arrester Kg	150	150

MEDIUM STATION PBC

S No	Description	24kV 10kA SL	24kV 10kA SM
	Model	PBC	PBC
	OUTDOOR/ INDOOR		
	System earthing		
1	Highest system voltage kV rms	24	24
2	Nominal system voltage kVrms	22	22
3	Ur –Rated voltage kVrms	24	24
4	Uc –MCOV(kVrms)	20	20
5	In –NDC (8/20 μ s) kA	10	10
6	Arrester classification	Station Low duty	Station Medium Duty
7	Qrs(IEC 99-4 Ed.3) in coulomb	1	1.6
8	Wth (IEC 99-4 Ed.3) in kJ/kV	4	7
9	Qth (IEC 99-4 Ed.3) in coulomb		
10	Max RDV kVp		
	a)5kA	68	64
	b)10kA	72	68
	c)20kA	80	76
11	Max. Switch. Imp. RDV(kVp)		
	a)500A	57	
	b)1000A		54
	c) 2000A		
12	Max. Steep Current impulse RDV(kVp) at NDC	80	76
13	High current impulse withstand value (4/10 μ s) kA	100	100
14	TOV (kVp)		
	i. 0.1	42	42
	ii.1.0Sec	41	41
	iii. 10.0Sec	39	39
	iv. 100.0Sec	37	37
15	Short circuit current kA	40	40
16	Insulation Withstand		
	a)Lightning Impulse (kVp)	As per IEC 60099-4 2014	As per IEC 60099-4 2014
	b)Power frequency kVrms	As per IEC 60099-4 2014	As per IEC 60099-4 2014
	c)Switching Imp (Wet)(kVp)	NA	NA
17	Rated frequency (Hz)	48 to 62	48 to 62
18	Leakage current		
	a.IR at MCOV in μ A	Less than 400	Less than 400
	b. IC at MCOV in mA	About 1.2	About 1.4
19	Reference voltage in Volt at Reference current in mA	> 24kV at 2mA	> 24kV at 3mA
20	Partial discharge P.D	10pC	10pC
21	Creepage distance–mm (min) Phase to Phase	25mm/kV /31mm/kV (as applicable)	25mm/kV /31mm/kV (as applicable)
22	Max. Cantilever strength of arrester Kg	150	150

Exports/Technical :

Ms.Bhargavi

Ph: +91 89770 89857

E : bhargavi@oblum.co.in

overseas@oblum.co.in

Technical :

Mrs. Nagalakshmi

Ph :+91 9848352440

E : nagalakshmi.k@oblum.co.in

technical@oblum.co.in

Oblum Electrical Industries (P) Ltd.

#A-16&17, Assisted Private Industrial
Estate, Balanagar,Hyderabad - 500 037

Land Line: 040-2377 1880

GST : 36AAACO2289A1ZQ

www.oblum.co.in

